


TOP VIEW

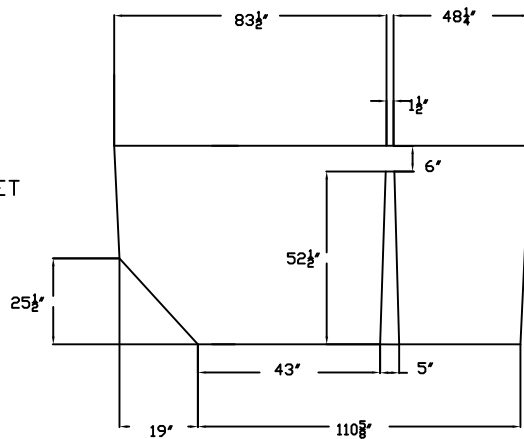

SIDE VIEW

TANK: CATEGORY 3. 3" 500 GPD AQUAKLEAR 4 COMPARTMENT TANK REINFORCED WITH FIBRILLATED POLYPROPYLENE FIBER. 3" WALLS AND 3" BOTTOM. INLET AND OUTLET RESILIENT CONNECTORS PER ASTM-923-98. CONNECTORS MUST BE USED WITH APPROVED CLAMP. CONNECTOR WILL ACCEPT 4" PVC PIPE.

LIDS: 3" LID WITH 4-22" ROUND MANHOLE COVER
 8" LID WITH 4-22" ROUND MANHOLE COVER
 LID IS REINFORCED WITH GRADE 60 REBAR.

TANK & LIDS: 4000 PSI CONCRETE AT 28 DAYS

IMPRINTED ON INLET END OF TANK:

LEGEND: FSI 500B STATE APPROVAL NUMBER: 01-011-AK5B-C3

WEIGHTS: TANK ONLY 13,550
 TANK & 5" LID 17,500
 TANK & 8" LID 21,400

THIS SEWAGE TREATMENT RECEPTACLE HAS BEEN DESIGNED, CONSTRUCTED AND STRUCTURALLY TESTED IN ACCORDANCE WITH CHAPTER 64E-6.013, FLORIDA ADMINISTRATIVE CODE, (FAC) DATED APRIL 28, 2010.

DRAWING NOT TO SCALE

FLORIDA SEPTIC, INC

P.O. BOX 545
 HAWTHORNE, FLORIDA 32640
 (800) 940-8265

MODEL:

3" 5B3 AQUAKLEAR TANK

REVISED:
 05/01/2011

APPROVAL DATE:
 AUGUST 27, 2007